


A product by Gorman Industries Inc. PH: 505-247-1596 www.gormanindustries.com

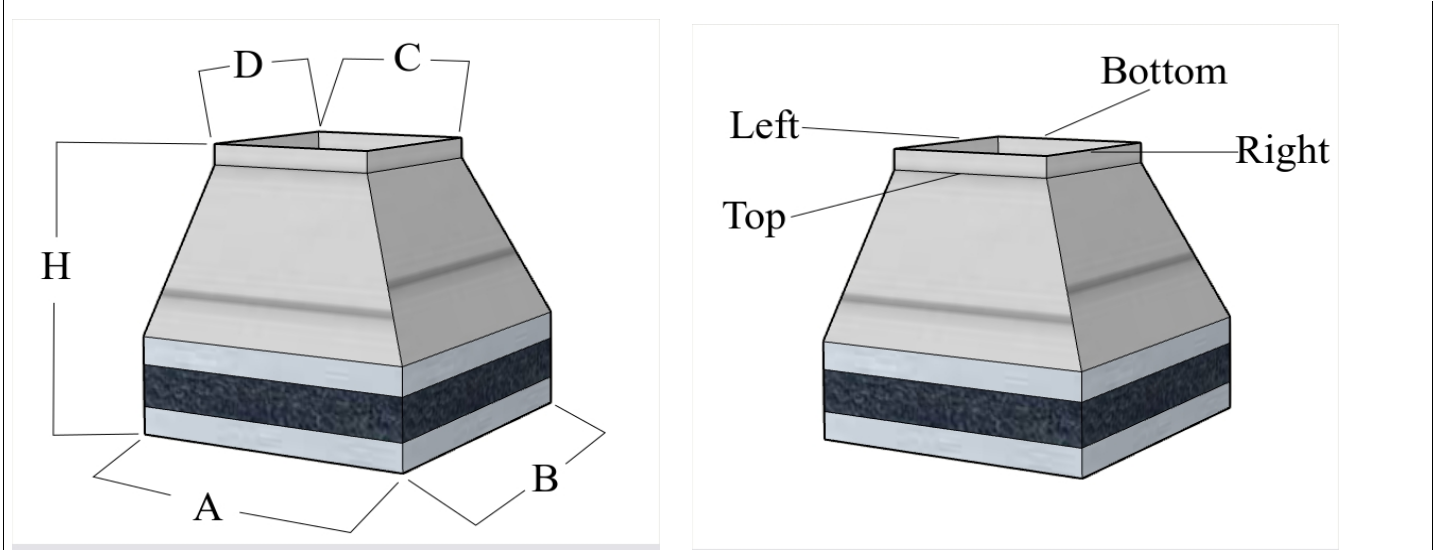

Furnace Transition

Qty	A	B	C	D	H	Connection A	Connection B	Connection C	Connection D
-----	---	---	---	---	---	--------------	--------------	--------------	--------------

Off set options

	Flat	In	Out
Bottom			
Top			
Right			
Left			
Flex	N/A	MBX	JGL

Filter Rack	N/A	1"	2"
-------------	-----	----	----

Filter rack adds 4" to minimum height

Butter Fly Damper	Yes	No
-------------------	-----	----

Butter Fly damper may not be possible with all heights

MBX= Commercial JGL= Residential

Total height includes Flex connector. There needs to be a minimum of 8" total height with residential flex and 10" for commercial flex

Construction: G90 galvanized, pittsburgh seams, .25" stiffening bead every 12" on center +2" W.G. SMACNA STANDARDS

Email orders to nicholas@gormanindustries.com